

Plumbing Solutions – edition 2

Bedding & Backfilling of Drains

Bedding of Drains Section 5 of AS/NZS 3500.2 Sanitary Plumbing and Drainage – Acceptable Solutions specifies the requirements for the excavation, bedding, support and backfilling of drains.

Inspections of drainage installations have revealed that some plumbing contractors are not supporting or bedding the drain correctly and backfilling with material containing soil lumps larger than 75mm.

Plumbing contractors need to be aware of and comply with the requirements for the installation of sanitary drains. If the following procedures are not followed drainage materials can be damaged and leaking may result in structural damage to buildings.

AS/NZS3500.2 Sanitary Plumbing and drainage

5.4.1 General

The bedding onto which drains are laid shall provide adequate and continuous support while accommodating the loads from the pipeline and backfill material. Bedding of drains shall comply with the following:

- a) In stable soil, drains shall be directly supported on the undisturbed base of the trench, provided that the base of the trench is free from any rocks or tree roots.
- b) In loam, clay, rock, shale, gravel or ground containing hard objects, drains shall be supported on a bedding material placed in the base of the trench.

5.4.2 Bedding materials

Filling materials used for bedding of drains (see figure 5.1) shall comply with one of the following:

- a) Crushed rock, gravel screenings or recycled crushed concrete, roof tiles or bricks of nominal sizes 7-10mm.
- b) Cement mortar containing one part of Portland cement and four parts of sand by volume thoroughly mixed with clean water to a workable consistency.
- c) Cement mortar bedding shall be used where the base of the trench is rock or shale and where the grade is greater than 20% and it shall
 - i) be a minimum depth of 50mm measured below the barrel of the pipe;
 - ii) be not less than 75mm wide;
 - iii) be kept clear of flexible joints; and
 - iv) have pipes supported at not greater than 1.5m from the centre, prior to placing the mortar bedding.
- d) Sand shall be free running, capable of passing through a 2mm mesh sieve, and shall not contain clay, organic or any other deleterious materials.



Example of Properly Bedded Drain

5.4.3 Pipe side support and overlay materials

Pipe side support and pipe overlay material shall not be inferior to the pipe bedding material.

5.4.4 Bedding and backfill

The sanitary drainage services shall be surrounded with not less than 75mm of compacted sand, or fine-grained soil, with no hard-edged object permitted to come in contact with or rest against any pipe or fitting (see figure 5.1)

Drains shall be backfilled with appropriate materials.

SA Water officers will be conducting audits to ensure that the bedding, laying, supporting and backfilling requirements for drains complies with AS/NZS3500 Plumbing and Drainage Standard

- Spoil from the excavation of the trench may be used provided it is free from rock or hard matter larger than 25mm and broken up so that it contains no soil lumps larger than 75mm.
- Backfill material shall be free of builder's waste, bricks and concrete.
- The backfill shall be compacted to restore the trench as near as practicable to the surface ground level.

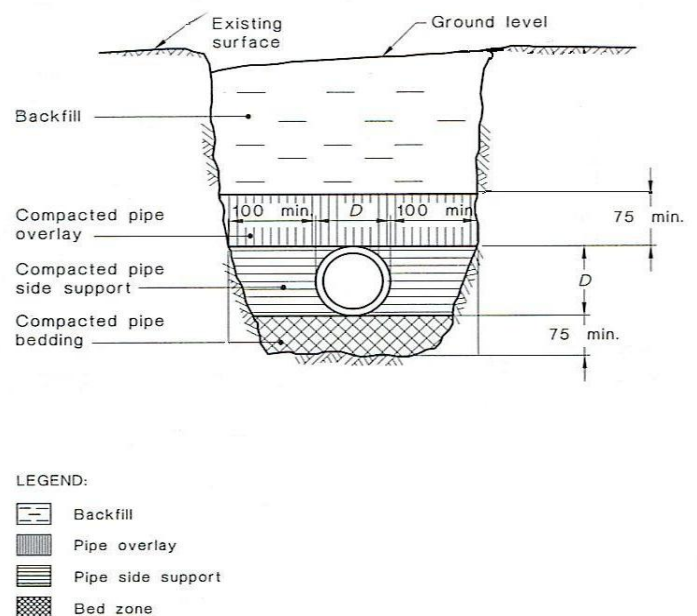


Figure 5.1 Typical Bedding of Drains
(dimensions in millimetres)

If you have any questions about bedding and backfilling of drains or the AS/NZS 3500 Plumbing and Drainage Standards or alternatively, if you would like copies of this or various editions of Plumbing Solutions, please contact Plumbooking on (08) 7424 1360 or email plumbooking@sawater.com.au

We welcome your feedback. If you have any comments about Plumbing Solutions, or wish to suggest some topics to be covered in future editions please send us an email to plumbooking@sawater.com.au