


94-0164-09A


ISSUED 6 Jan 97

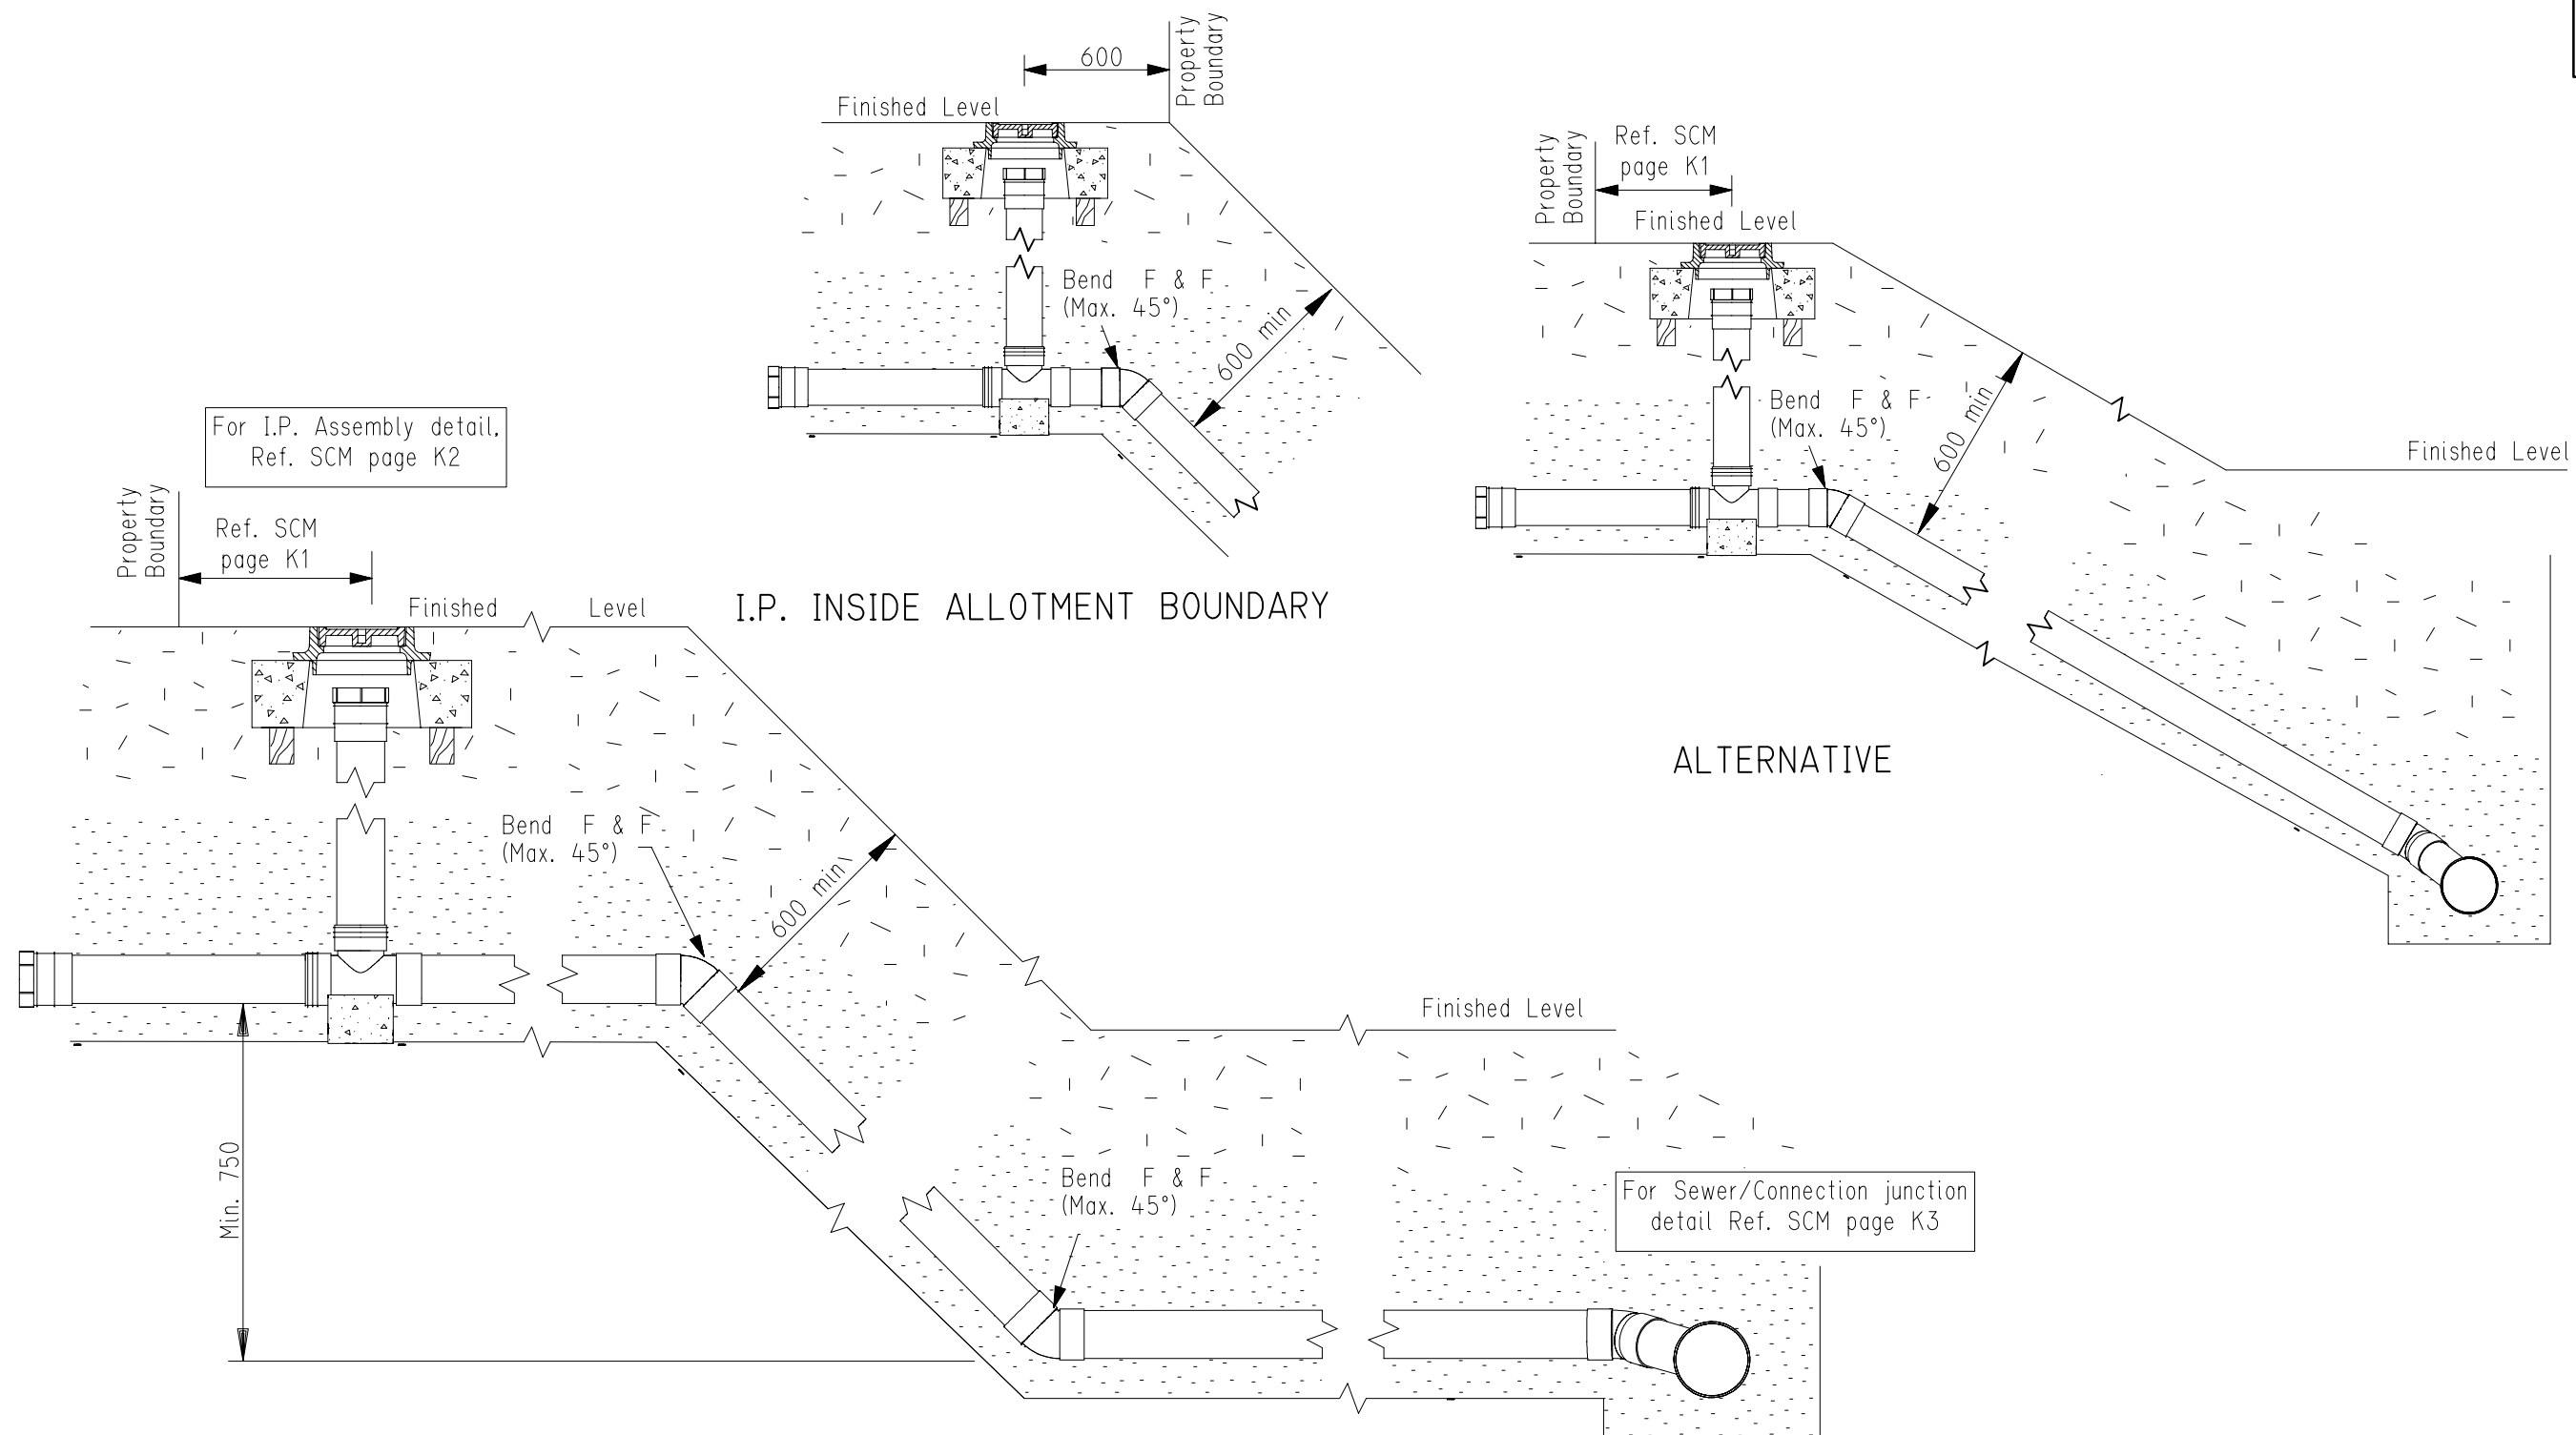

NOTES:

1. Minimum connection gradient is 2.00% for DN 100 and 1.00% for DN 150.
2. Connection length not to exceed 30 metres
For connections over 20 metres, an intermediate IP shall be installed to the surface at mid length.
3. Embedment and Trench Fill to be similar to that for a DN 150 UPVC sewer, as detailed in SCM Section 'G'.

Only "AUTHORISED" items shall be used in the Sewer System.

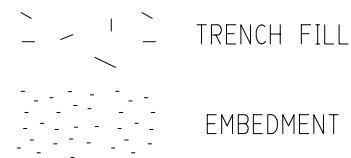

PIPE MATERIALS
Details on this drawing are applicable to connections off UPVC sewers using:-
* approved UPVC plain wall pipes with solvent cement joints, and
* approved UPVC ribbed pipes fitted with dual rubber rings at each joint.

DB 94-0164 Plot 09

Chg	A	Amendment - 13-6-96	Des	J.I.S.	Amendment Authorisation
Drn	C.S.	1. Title Block amended	Drn	C.S.	R.M.Jones
Ckd		2. Note 2 amended	Exm		Executive Manager 14 / 6 / 96
Unit Ldr.			Unit Ldr.		ENGINEERING GROUP

SOUTH AUSTRALIAN WATER CORPORATION

**SEWER CONSTRUCTION MANUAL PAGE K8
DN 100 & 150 UPVC CONNECTIONS
THROUGH EMBANKMENT**

Not to Scale

© This drawing is the property of the South Australian Water Corporation and shall not be copied without permission.

94-0164-09A