


ACCESS STAIRS PLAN
SCALE 1:50

NOTES:

1. NUMBER OF LANDINGS IS DEPENDANT ON TANK EXTERNAL WALL HEIGHT. VERTICAL SPACINGS BETWEEN LANDINGS SHOULD BE EQUAL, WHERE POSSIBLE, WITH A MAXIMUM LIMIT OF 18 RISERS, IN ACCORDANCE WITH AS 1657 AND TS 150.
2. STAIRS AND LANDINGS SHALL BE ANGLED TO MINIMISE DISTANCE TO TANK WALL.
3. STAIRS GEOMETRY SHALL BE IN ACCORDANCE WITH AS 1657 AND TS 150.
4. CONDITION OF CONCRETE WALL SHALL BE ASSESSED PRIOR TO INSTALLATION OF ANCHORS FOR STAIR SUPPORTS.
5. THE MINIMUM CLEARANCE BETWEEN THE LOWER MOST LANDING AND THE GROUND SURFACE SHALL BE 3.0m.

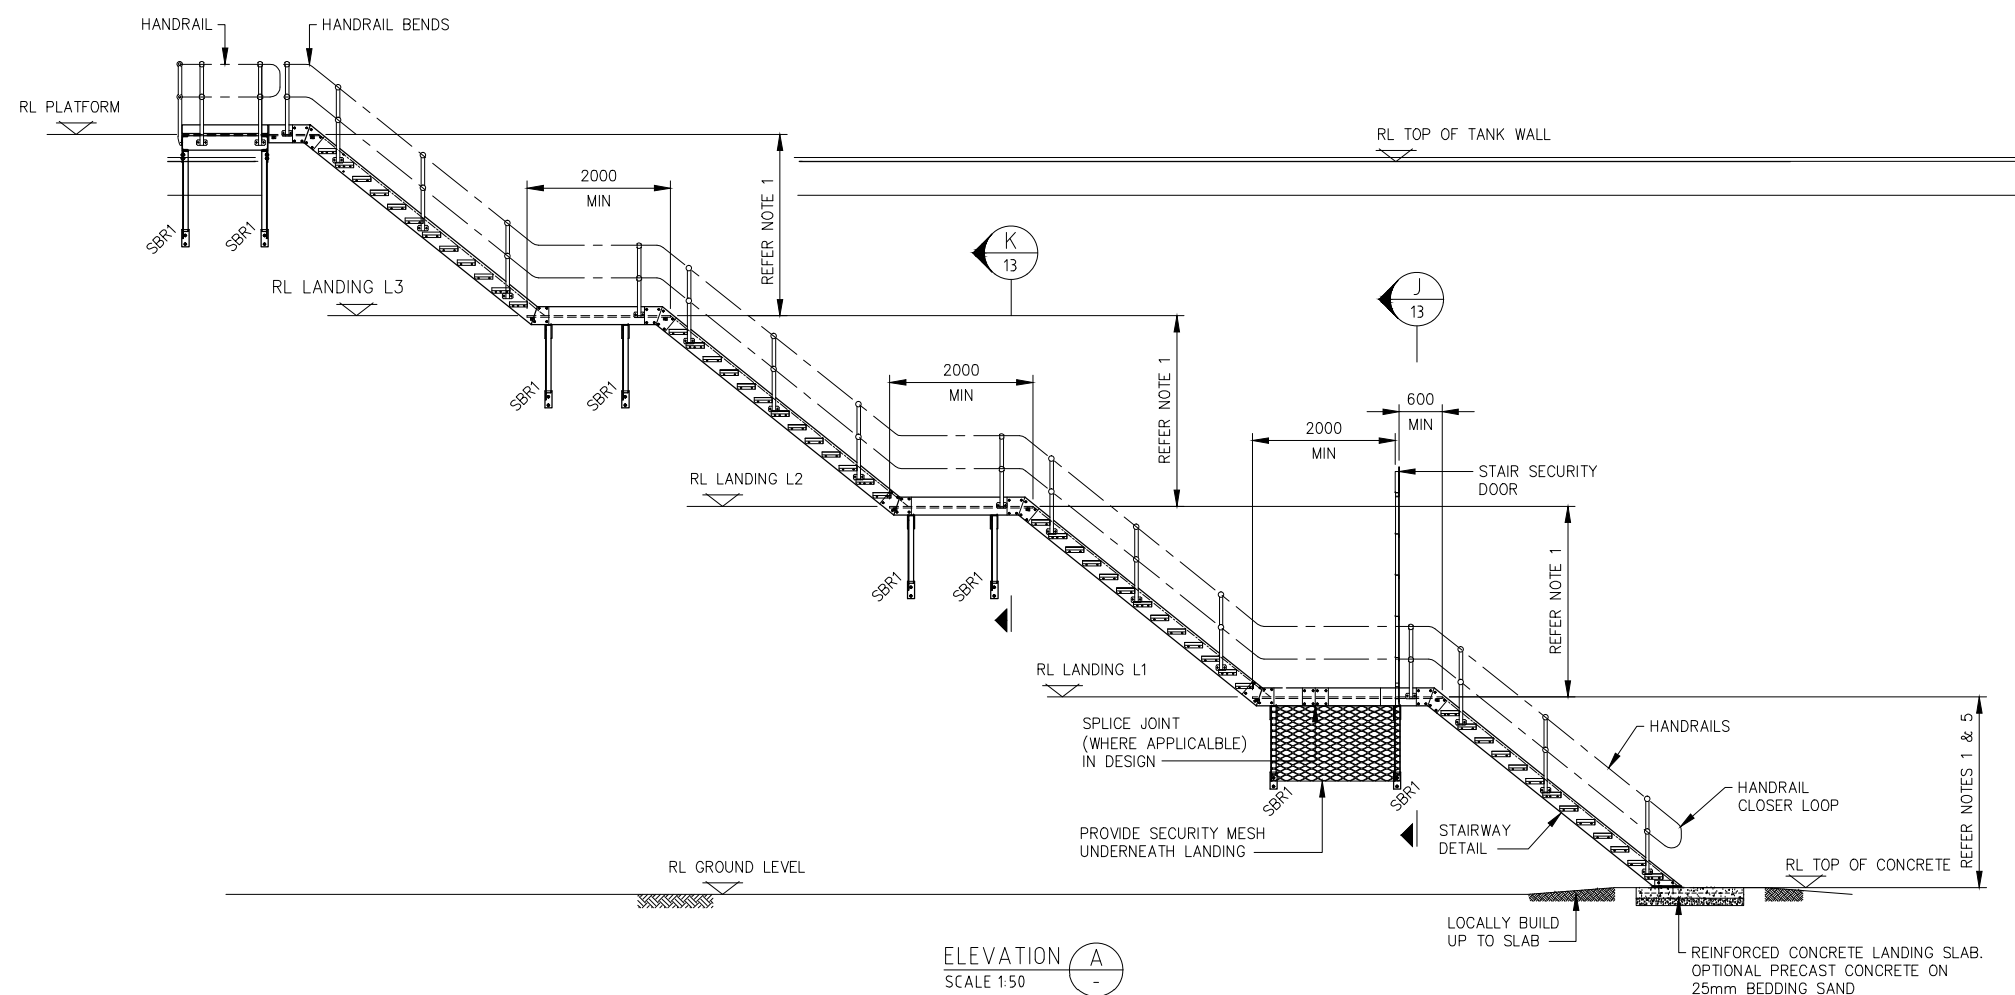

ELEVATION A
SCALE 1:50

NOT FOR CONSTRUCTION

0 500 1000 2000 3000
Full Size 1:50 ; Half Reduction 1:100
SCALE (mm)

REVISION PANEL				
REV	DATE	DRN	DETAILS	APR'D
1	06/06/16	SS	ISSUED FOR USE	H.H.

DESIGN PANEL				
DESIGNED	JUN 2016	AUTHORISED	07/06/2016	
SA WATER		HANY HABIB		
DRAWN	JUN 2016	SIGNATURE		
SA WATER				
REVIEWED	JUN 2016			
SA WATER				

This drawing is the property of the
SOUTH AUSTRALIAN
WATER CORPORATION
and shall not be copied or modified
in part or in whole without authorization.

SA WATER TYPICAL DRAWING
ABOVE GROUND TANK SAFE ACCESS
STAIRWAY ACCESS AND LANDINGS
ARRANGEMENT AND DETAILS

A1	1
SHT SIZE	REVISION
TOTAL SHEETS: 12 OF 16	
SUPERSEDES:	
DRAWING NUMBER	
5007-00001-12	
YEAR	SHEET
12	1