



Engineering

Technical Standard

TS 0504 – Authorised Products – Packaged Sewer Pumping Stations

Version: 1.2

Date: 15 March 2022

Status: Final

Document ID: SAWS-ENG-0504

© 2022 SA Water Corporation. All rights reserved. This document may contain confidential information of SA Water Corporation. Disclosure or dissemination to unauthorised individuals is strictly prohibited. Uncontrolled when printed or downloaded.



**Government of
South Australia**

Copyright

This Standard is an intellectual property of the South Australian Water Corporation. It is copyright and all rights are reserved by SA Water. No part may be reproduced, copied or transmitted in any form or by any means without the express written permission of SA Water.

The information contained in this Standard is strictly for the private use of the intended recipient in relation to works or projects of SA Water.

This Standard has been prepared for SA Water's own internal use and SA Water makes no representation as to the quality, accuracy or suitability of the information for any other purpose.

Application & Interpretation of this Document

It is the responsibility of the users of this Standard to ensure that the application of information is appropriate and that any designs based on this Standard are fit for SA Water's purposes and comply with all relevant Australian Standards, Acts and regulations.

Users of this Standard accept sole responsibility for interpretation and use of the information contained in this Standard. Users should independently verify the accuracy, fitness for purpose and application of information contained in this Standard.

Only the current revision of this Standard should be used which is available for download from the SA Water website.

Significant/Major Changes Incorporated in This Edition

This revision updates the August 2020 edition of TS 0504 Authorised Products – Packaged Sewer Pumping Stations. The clause numbers described below identify changes from version 1.1

Clauses 1

Introduction text updated

Clause 1.1

Purpose updated

Clause 1.2

Glossary updated

Clause 1.3.2

Table updated

Clause 1.4

Definitions table updated

Clause 1.5

Disclaimer updated with SiD information

Clause 2

Scope updated with SiD information

Clause 2.1

New Clause to address safety in Design requirements.

Clause 3

Pump station information updated with SiD information

Clause 4.1

Manufacturer removed – Caprari/CPC

Clause 5

Educt vents product information clarified.

Document Controls

Revision History

Revision	Date	Author	Comments
1.0	8 April 2016	R Pearce	
1.1	11 August 2020	K Claridge	Refer Pg 2 for identified changes in this revision
1.2	15 March 2022	K Claridge	Refer Pg 2 for identified changes in this revision

Template: Technical Standard Version 6.00, 10/05/2016

Approvers

Role	Signature and Date
Responsible Discipline Lead Kevin Claridge	15/03/2022 X  ----- Signer's Name Signed by: CL001730
Manager Engineering Quality and Innovation Matthew Davis	15/03/2022 X  ----- Signer's Name Signed by: DA003681
Senior Manager Engineering Services Richard Gray	16/03/2022 X  ----- Signer's Name Signed by: GR001964

Reviewers

Role	Name	Revision	Review Date
Engineering Safety In Design Specialist	Lana Haigh	1.2	07/02/2022
Manager Eng Quality and Innovation	Matthew Davis	1.2	08/02/2022
Reticulation Networks Specialist	Kevin Claridge	1.2	07/03/2022

Contents

1	Introduction	5
1.1	Purpose	5
1.2	Glossary	5
1.3	References	6
1.3.1	Australian and International.....	6
1.3.2	SA Water Documents.....	6
1.4	Definitions	6
1.5	Disclaimer	7
2	Scope	8
2.1	Safety in Design.....	8
3	Package Pump Station Information	9
4	Package Pump Station Providers	10
4.1	Global Group	10
4.2	Xylem	11
5	Educt Vents	12

1 Introduction

SA Water is responsible for operation and maintenance of an extensive amount of engineering infrastructure.

This standard has been developed to assist in the design, maintenance, construction, and management of this infrastructure such that it is safe and fit for purpose. This document lists technically conforming products approved for installation within SA Water's infrastructure networks and the Safety in Design (SiD) process requirements for the pump station design and designs they are incorporated into.

The products listed have been approved after their evaluation based upon the SA Water product appraisal procedure.

Approved products shall only be obtained from the listed manufacturer or their authorised agent.

1.1 Purpose

The purpose of this standard is to detail minimum requirements to ensure that assets covered by the scope of this standard are constructed and maintained to consistent standards and attain the required asset life.

This document provides confirmation of products SA Water has authorised, based on their technical merits.

Product Manufacturers, suppliers and other stakeholders may also use the information as reference material.

SA Water personnel should source items from the Store. If not stocked they should procure by means of:

- utilising the relevant SA Water Period Contract or Standing Offer Arrangement,
- where an item is not covered under a Contract or Standing Offer Arrangement, contacting a relevant Stores or Procurement Officer.

1.2 Glossary

The following glossary items are used in this document:

Term	Description
SA Water	South Australian Water Corporation
SiD	Safety in Design
TG	SA Water Technical Guideline
TS	SA Water Technical Standard

1.3 References

1.3.1 Australian and International

The following table identifies Australian and International standards and other similar documents referenced in this document:

Number	Title
AS/NZS 1260	PVC pipes and fittings for drain, waste and vent (DWV) applications
AS/NZS 2032	Code of practice for the installation of PVC pipe systems
AS 3996	Access covers and grates
WHS Act	Work Health and Safety Act 2012 (SA)

1.3.2 SA Water Documents

The following table identifies the SA Water standards and other similar documents referenced in this document:

Number	Title
TS 0101	Safety in Design
TS112	Process and Instrumentation Diagrams
TS 0132	Operating and Maintenance Manuals
TS 0500	SA Water Authorised Products Water and Sewer Maintenance

1.4 Definitions

The following definitions are applicable to this document:

Term	Description
SA Water's Representative	The SA Water representative with delegated authority under a Contract or engagement, including (as applicable): <ul style="list-style-type: none"> • Superintendent's Representative (e.g. AS 4300 & AS 2124 etc.) • SA Water Project Manager • SA Water Construction Technical Officer/Manager • Reticulation Networks Wastewater/Water Specialist • SA Water nominated contact person
Responsible Discipline Lead	The engineering discipline expert responsible for TS 05044 defined on page 3 (via SA Water's Representative)
Constructor	The organisation responsible for constructing and installing infrastructure for SA Water whether it be a third party under contract to SA Water or an in-house entity.
Designer	The organisation responsible for designing infrastructure for SA Water whether it be a third party under contract to SA Water or a Constructor, or an in-house entity

1.5 Disclaimer

- SA Water reserves the right to alter, amend or withdraw this document, at any time, without prior notice.
- SA Water does not give preference to any particular make or type of product listed herein. Manufacturers are presented in alphabetical order, not in any order of preference.
- All products listed may be subject to change by the manufacturer. In such circumstances manufacturers are required to notify SA Water of any changes in the design, materials or manufacturing process of any approved product. SA Water is reliant upon manufacturers providing such notification in a timely manner and takes no responsibility for any issue that may arise should a manufacturer fail to do so.
- It is the responsibility of the Designer/ Constructor to ensure selected products are appropriate for the intended application.
- It is the responsibility of the Designer/ Constructor to ensure the product complies with the infrastructure category and meets the relevant Australian standards.
- It is the responsibility of the Constructor to ensure components do not exceed any expiry date.
- Product sizing may vary between manufacturers. Size range provided herein is a guide only and the Designer/ Constructor shall refer to the manufacturer for the product size and availability.
- Pipe and fitting sizing has been limited to DN200 throughout this document. Larger sizes are available from the manufacturer. However, consideration of any product not itemised herein is subject to SA Water approval.
- Information within this document is correct at time of publication. The date of publication of this document can be found on the front page, and in the left hand corner of the footer on each subsequent page.

2 Scope

This document specifies products that are authorised for use in packaged sewer pumping stations, that are installed in sewer systems. It also outlines the Safety in Design (SiD) requirements in order to meet the WHS Act (2012) legislative requirements.

NOTE: Authorised products for use in pumping mains (from Pumping Stations) up to a maximum size of DN 200, are detailed in TS 0502.

2.1 Safety in Design

The WHS Act outlines the duties of Designers when designing plant, structures or substances. Approved products, and designs they are incorporated into, must go through the SA Water Safety in Design (SiD) process, as outlined in Technical Standard TS 0101.

It is the responsibility of the Designer/Constructor to ensure that the SA Water Safety in Design process has been followed in accordance with TS 0101, and that the corresponding information is provided. This includes, but is not limited to, the SA Water SiD hazard register and SiD (Safety) Report.


All package pump stations are to have a completed SiD Hazard Register supplied by the manufacturer/supplier, which shall be updated during the design of specific installations. If a packaged pump station is supplied without the relevant safety in design information, the designer must request the provision of safety in design information and/or complete it themselves. All packaged sewer pump stations are to be supplied with an operations and maintenance manual.

3 Package Pump Station Information


All Fittings Shall Comply With Australian Standard	Refer: SA Water Technical Standard TS 0502 (Authorised Products for Gravity Sewer and Pressure Pumping Main Systems)
Specification	
Notes	<ul style="list-style-type: none"> • All package pump stations shall be in accordance with the Sewer Construction Manual (Section M), the Authorised Manufacturer Approved Drawing, and the Approved Design Drawings. • Approved Supplier Pumping Stations come as a Package, inclusive of a concrete sump, separate concrete valve chamber, electrical cabinet and vent. • Pumping Stations Sump shall be installed complete with covers, mechanical plant and equipment, pump bases, guide rails, pipework, level control mechanisms, lifting chains and all ancillary items. • Safety railing is a requirement. • Stations installed in highly corrosion environments shall require all steel items installed inside chamber to be Grade 316 Stainless Steel or other non corrosive materials as approved by SA Water. This includes the Pumps, Guiderrails etc. • Manufacturers are presented in alphabetical order. (Refer Disclaimer).

4 Package Pump Station Providers

4.1 Global Group

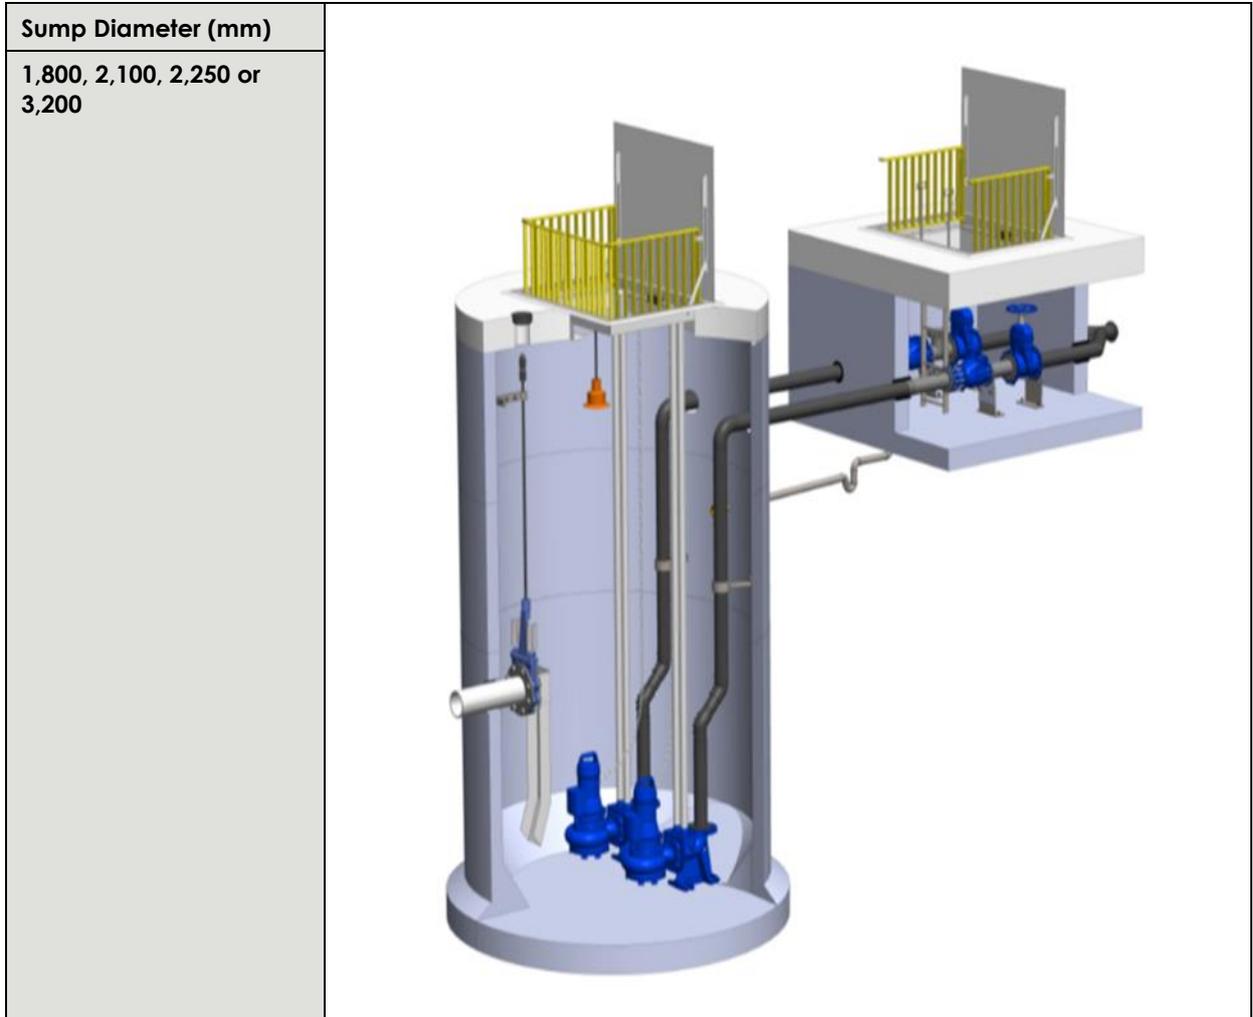

4.2 Xylem

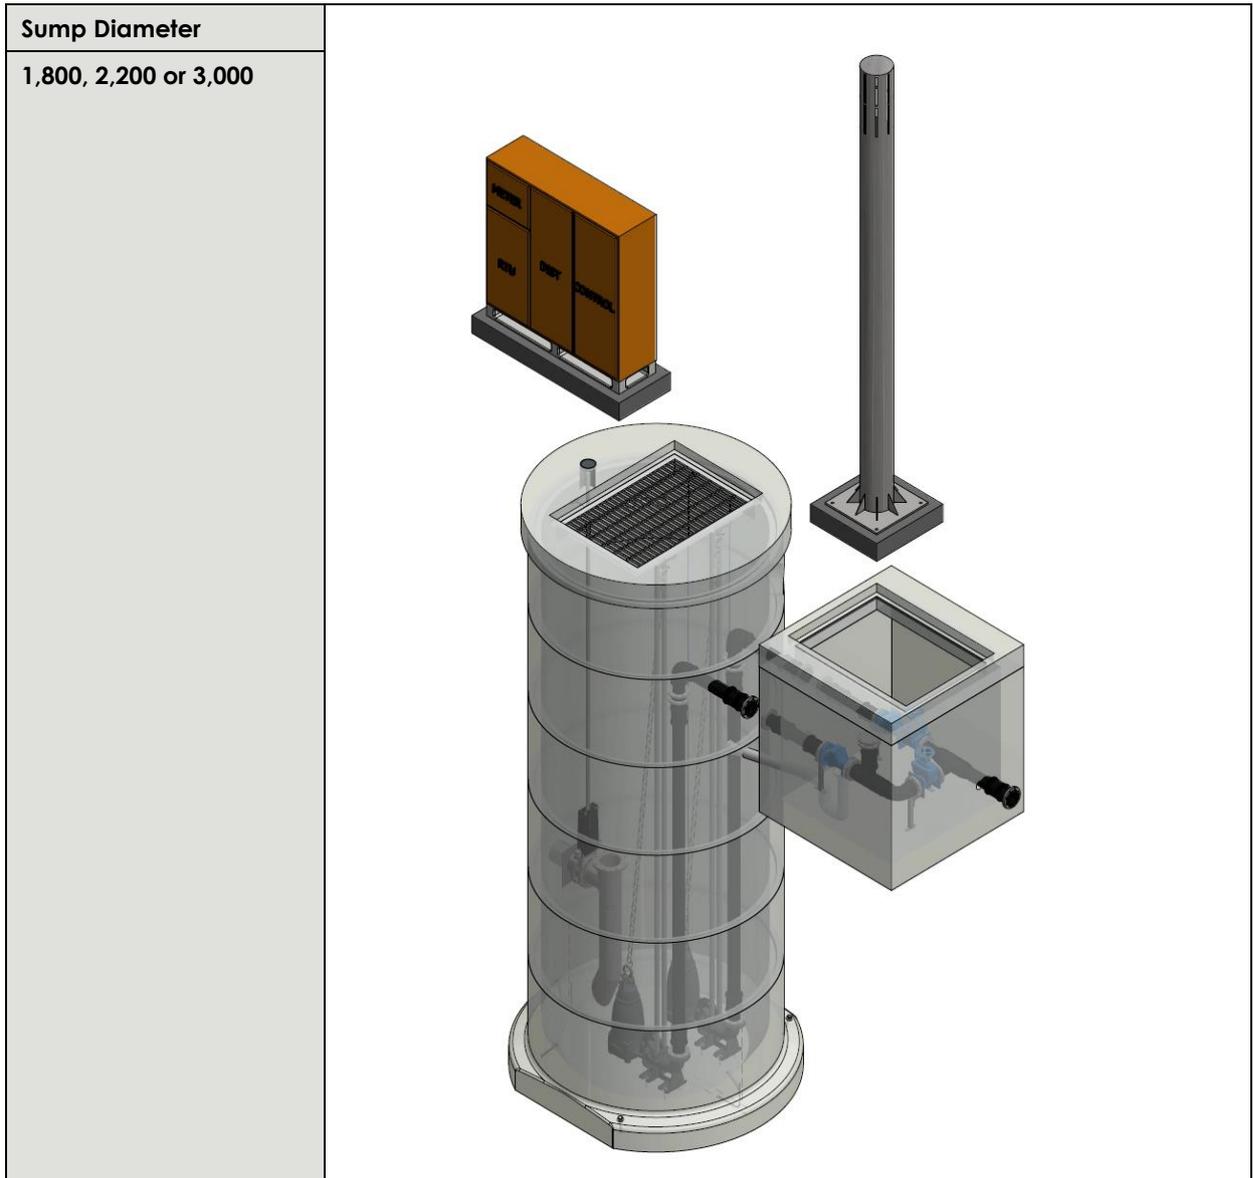

5 Educt Vents

Clauses in 4.8.1 of SA Water Technical Standard TS 0500 (Authorised Products Water and Sewer Maintenance) provide details of manufacturers, materials and dimensions.